





VICINITY MAP

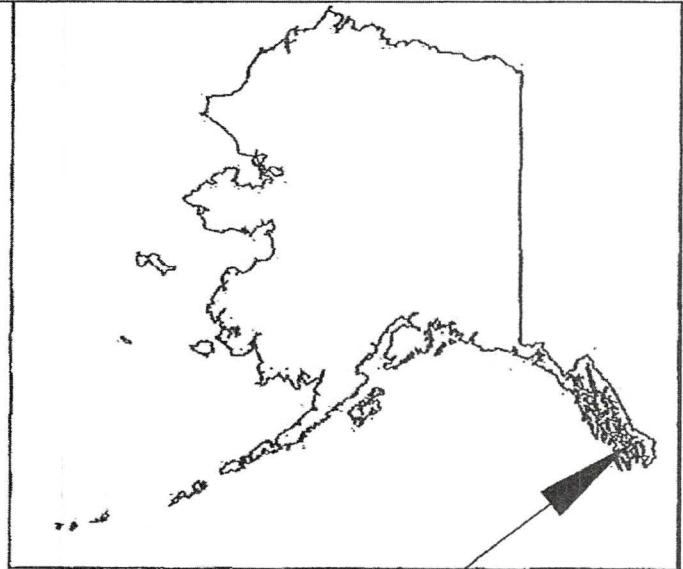


PROJECT LOCATION

POA-2013-210
H&A Development
Tongass Narrow
June 26, 2013
Sheet 1 of 5


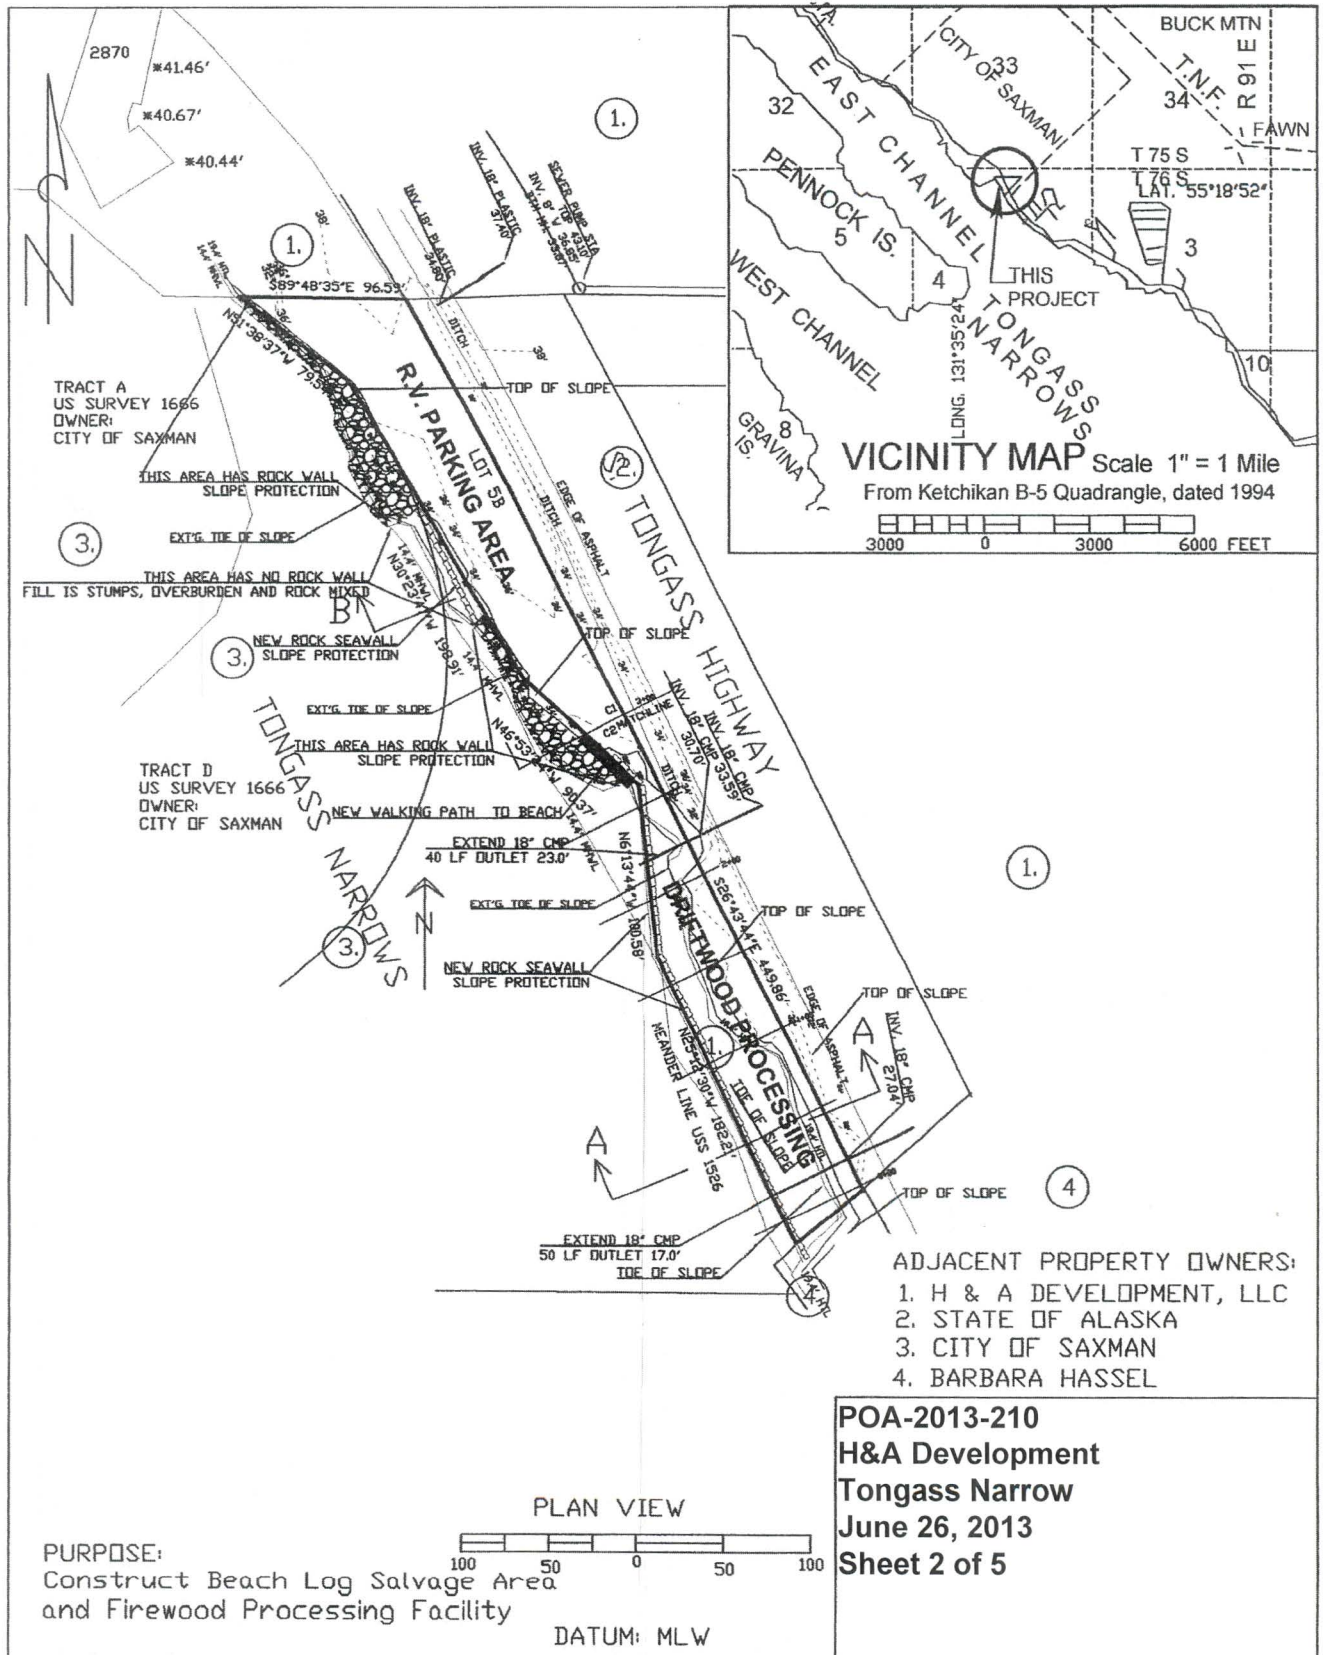


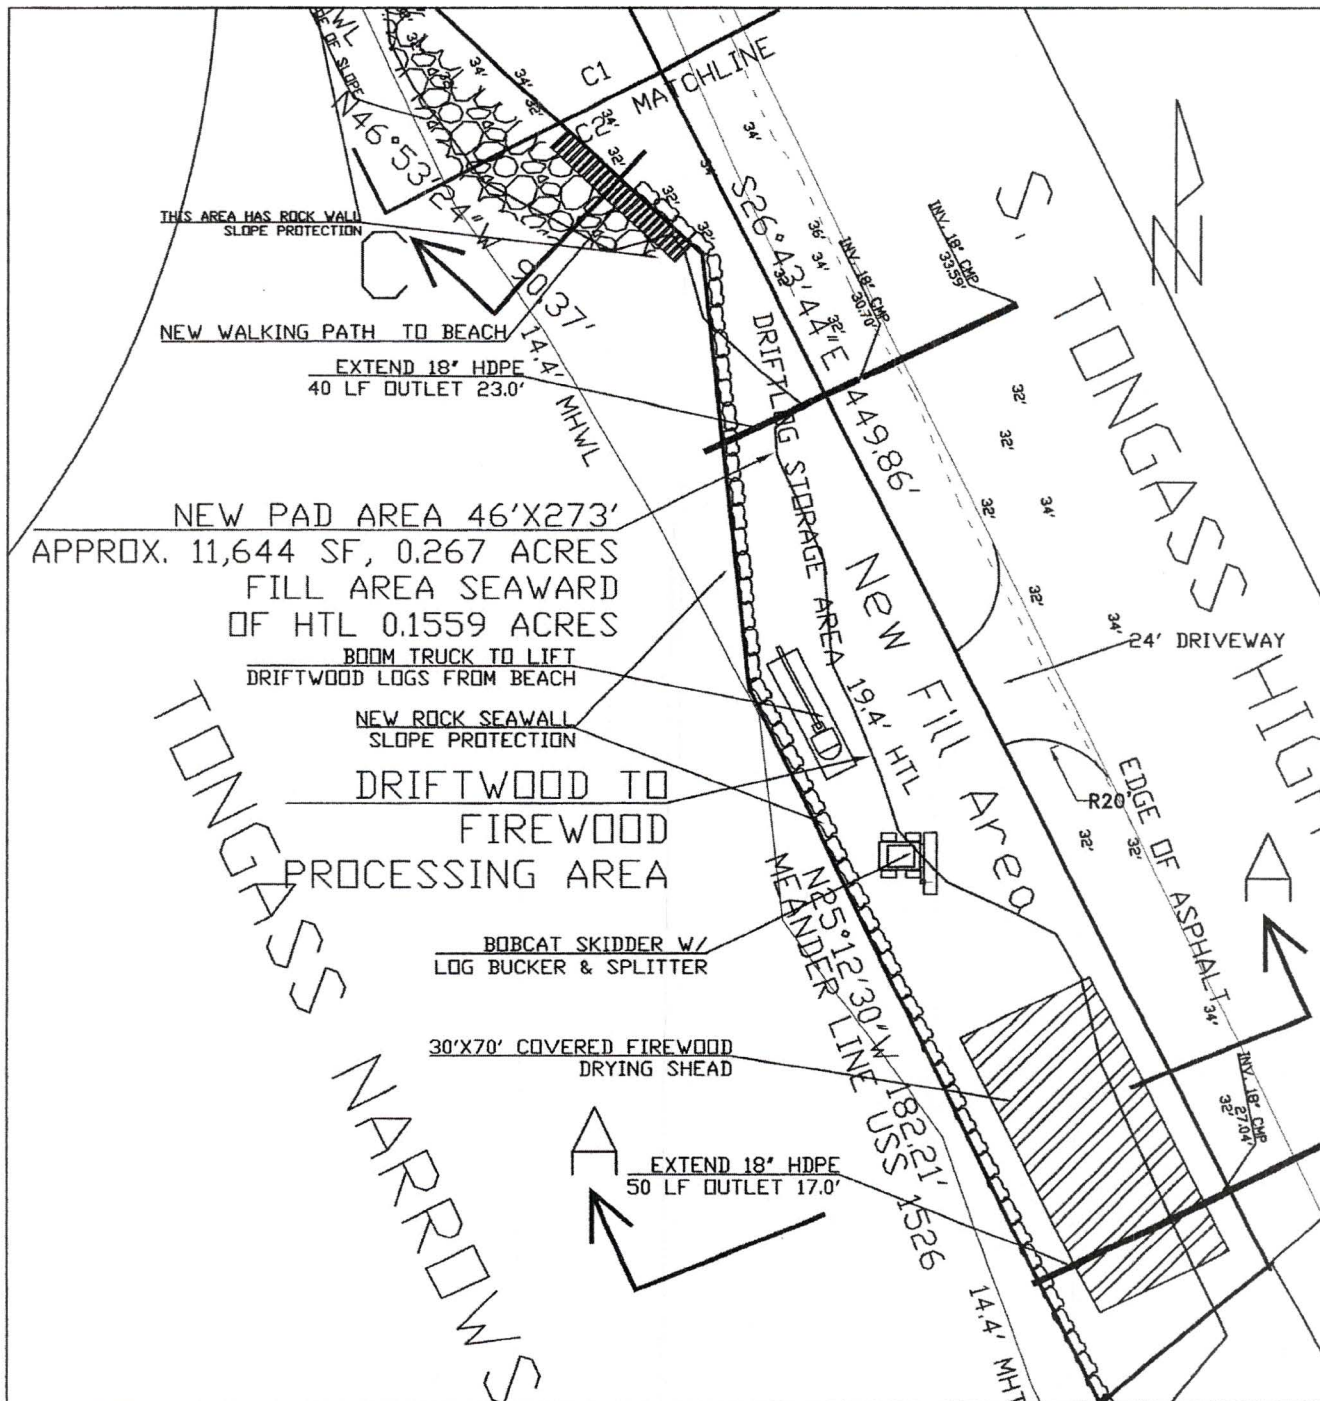


POA-2013-210
H&A Development
Tongass Narrows
June 26, 2013
Sheet 3 of 5

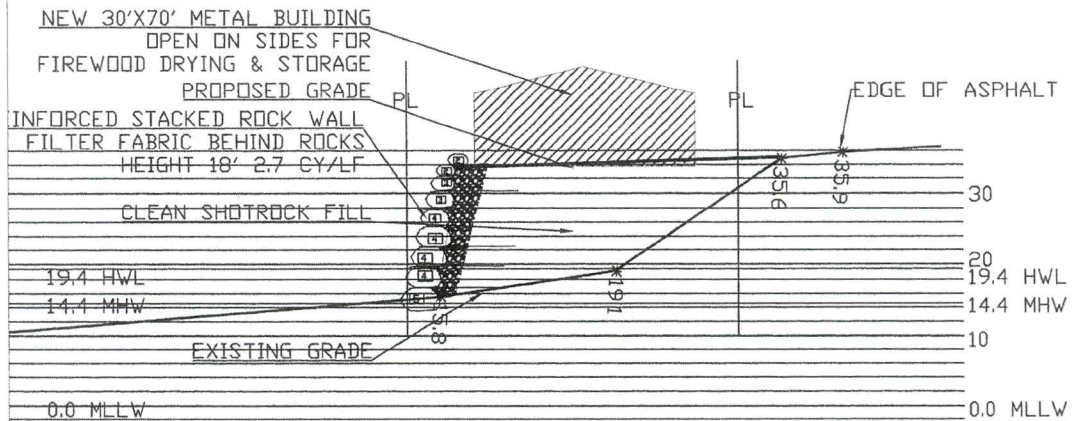

SECTION A-A

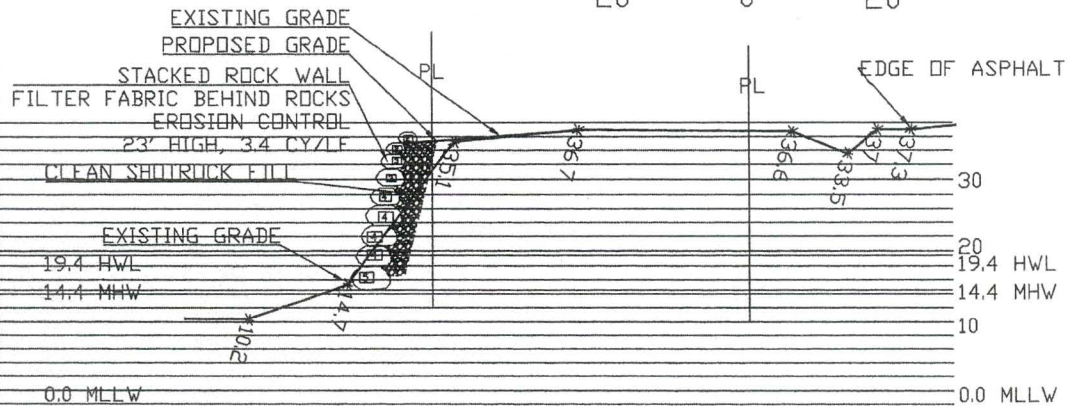

SECTION B-B



POA-2013-210
H&A
Development
Tongass Narrow
June 26, 2013
Sheet 4 of 5

FOLLOW ARC STANDARDS
 BACKFILL WALL W/2'-6" CLEAN SPALLS
 TYPAR FILTER FABRIC TO PREVENT LOSS OF BACKFILL FROM DRAINAGE
 WALL MUST BEAR ON CLEAN BEDROCK OR APPROVED BASE
 PLACE LONG STRETCHER ROCK ACROSS CORNERS TO TIE TOGETHER


"THE STACKED ROCK WALLS MUST BE INSPECTED BY & CERTIFIED THOUGH
 A QUALIFIED INDIVIDUAL F. MONREAN IS THE E.O.R. WHO WILL BE
 PERFORMING THESE INSPECTIONS. THE CITY DOES NOT TAKE
 RESPONSIBILITY FOR &/OR CERTIFYING THE CONSTRUCTION OF STACKED
 ROCK RETAINING WALLS. THE CITY SHOULD BE CALLED FOR THE REQUIRED
 INSPECTION, BUT AN INDEPENDENT INSPECTOR MUST CERTIFY THE WALLS."



Crushed Rock or Ranging Between 4 & 2"
 In Size and Free of Organics, Less Than
 5% Fines Compacted to 95%




4" ASD PERFORATED DRAIN PIPE 2% SLOPE
 TO DRAIN, WRAP IN FILTER FABRIC LIKE
 AMOCO 4504 OR 4546

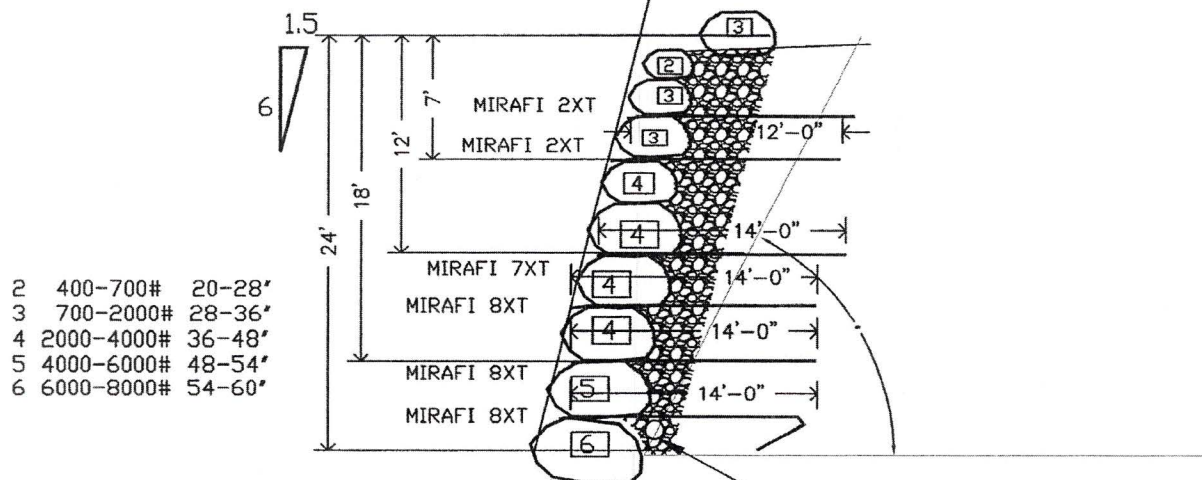

NEW ROCK WALL AS REQUIRED

4" ADS PERF. SUB-DRAIN

0 10 20

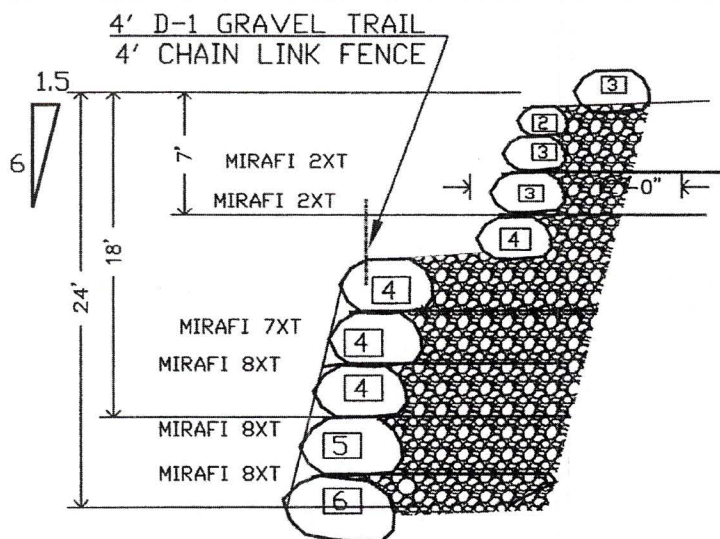

SECTION C

SCALE 1"=10'

DATUM: MLW

POA-2013-210
 H&A Development
 Tongass Narrow
 June 26, 2013
 Sheet 5 of 5